


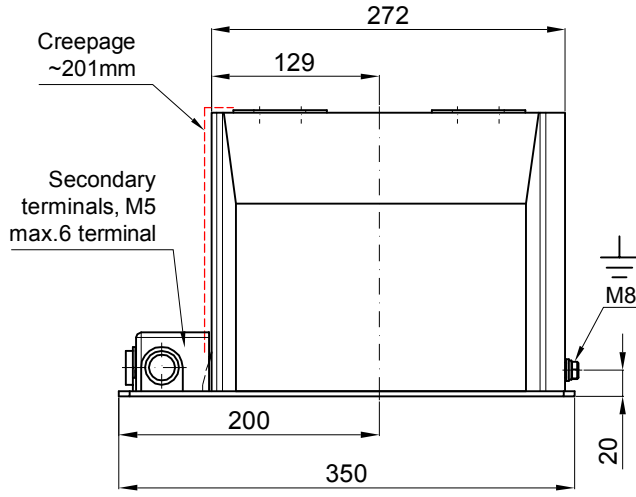
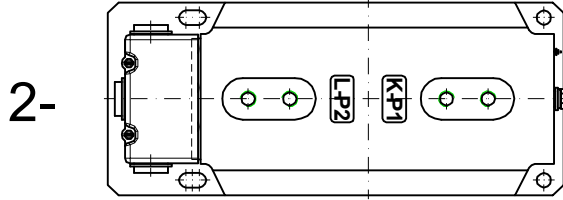
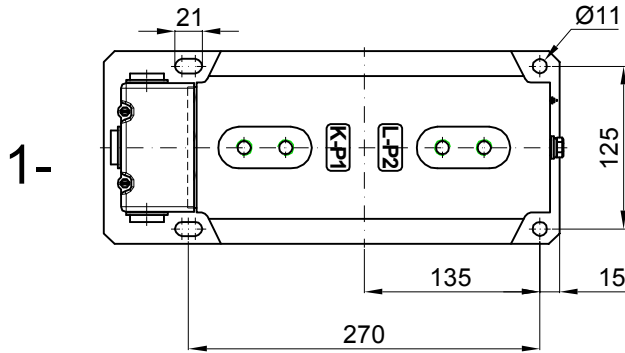
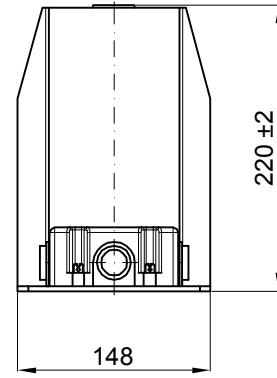


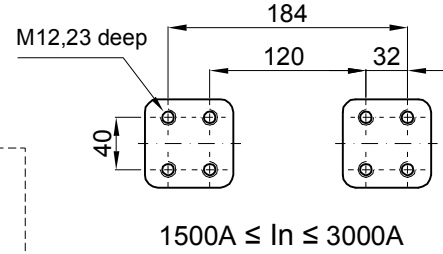

Acc.to DIN 42 600 (Teil-8)
Um : 12kV
Cantilever strength >5000N

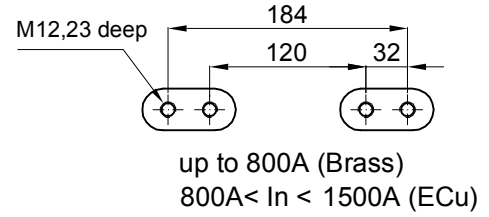


PRIMARY CONNECTION TERMINALS

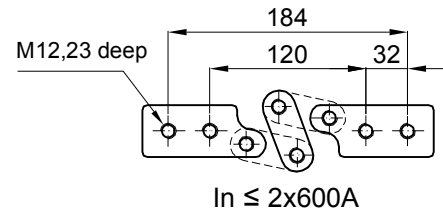


1500A ≤ In ≤ 3000A


SCREW	Tightening Torque Nm
M5	2-2,5
M8	16-20
M12	60-70



Secondary terminal's detail

DEĞİŞİKLİK
TEKNİK BÜRO
Tarih 21 / 07 / 2015

										Cast-Resin			
QTY	DESCRIPTION					POS	DIMENSIONS		WEIGHT	PART OR DIN NO.		MATERIAL	
	NO	DATE	NAME	MODIFICATION		D	26-09-14	Ayşe	Primary terminal changed.				
	A	08-11-04	Ayşe	Primary connection terminals		E	08-07-15	Arzu	View and dimensions was changed.				
	B	06-04-07	Arzu	Connection diagram of current range is changed .									
	C	19-09-14	Ayşe	Primary terminal changed.		-----		PLATE CODE		3009709			
	TOLERANS DIN ISO 2768-1 (c)		AB12 CURRENT TRANSFORMER					BOX CODE		3003005		REV.	
								359_1			E		
	SCALE -/-											REPLACES THE DRAWING NO.	
			 OG Ölçü Trafo					CH'D					
								APP'D					
								C.C		MT			



OG Ölçü Trafo